

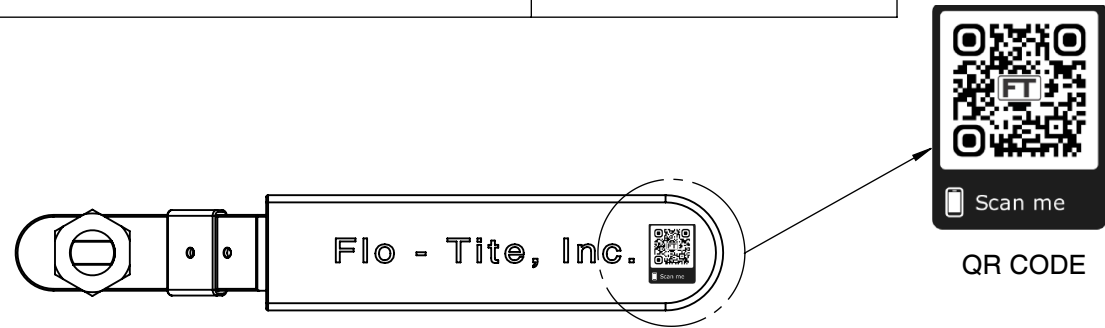




Tri-Pro Series	3000WOG	WCB	TFM Seat	HPF41-CS-1-F-G-G-L-10
FIRE SAFE API 607-7			SIZE 3/8"	

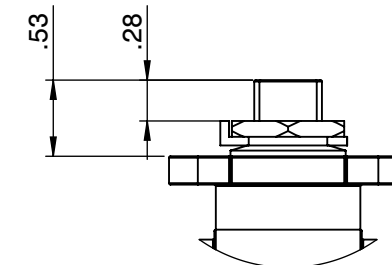

Actuator ISO Mounting Flange (F04)

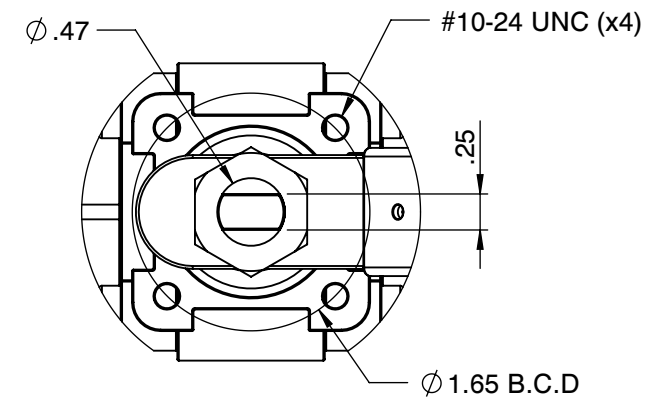

DETAIL : A
DETAIL : B

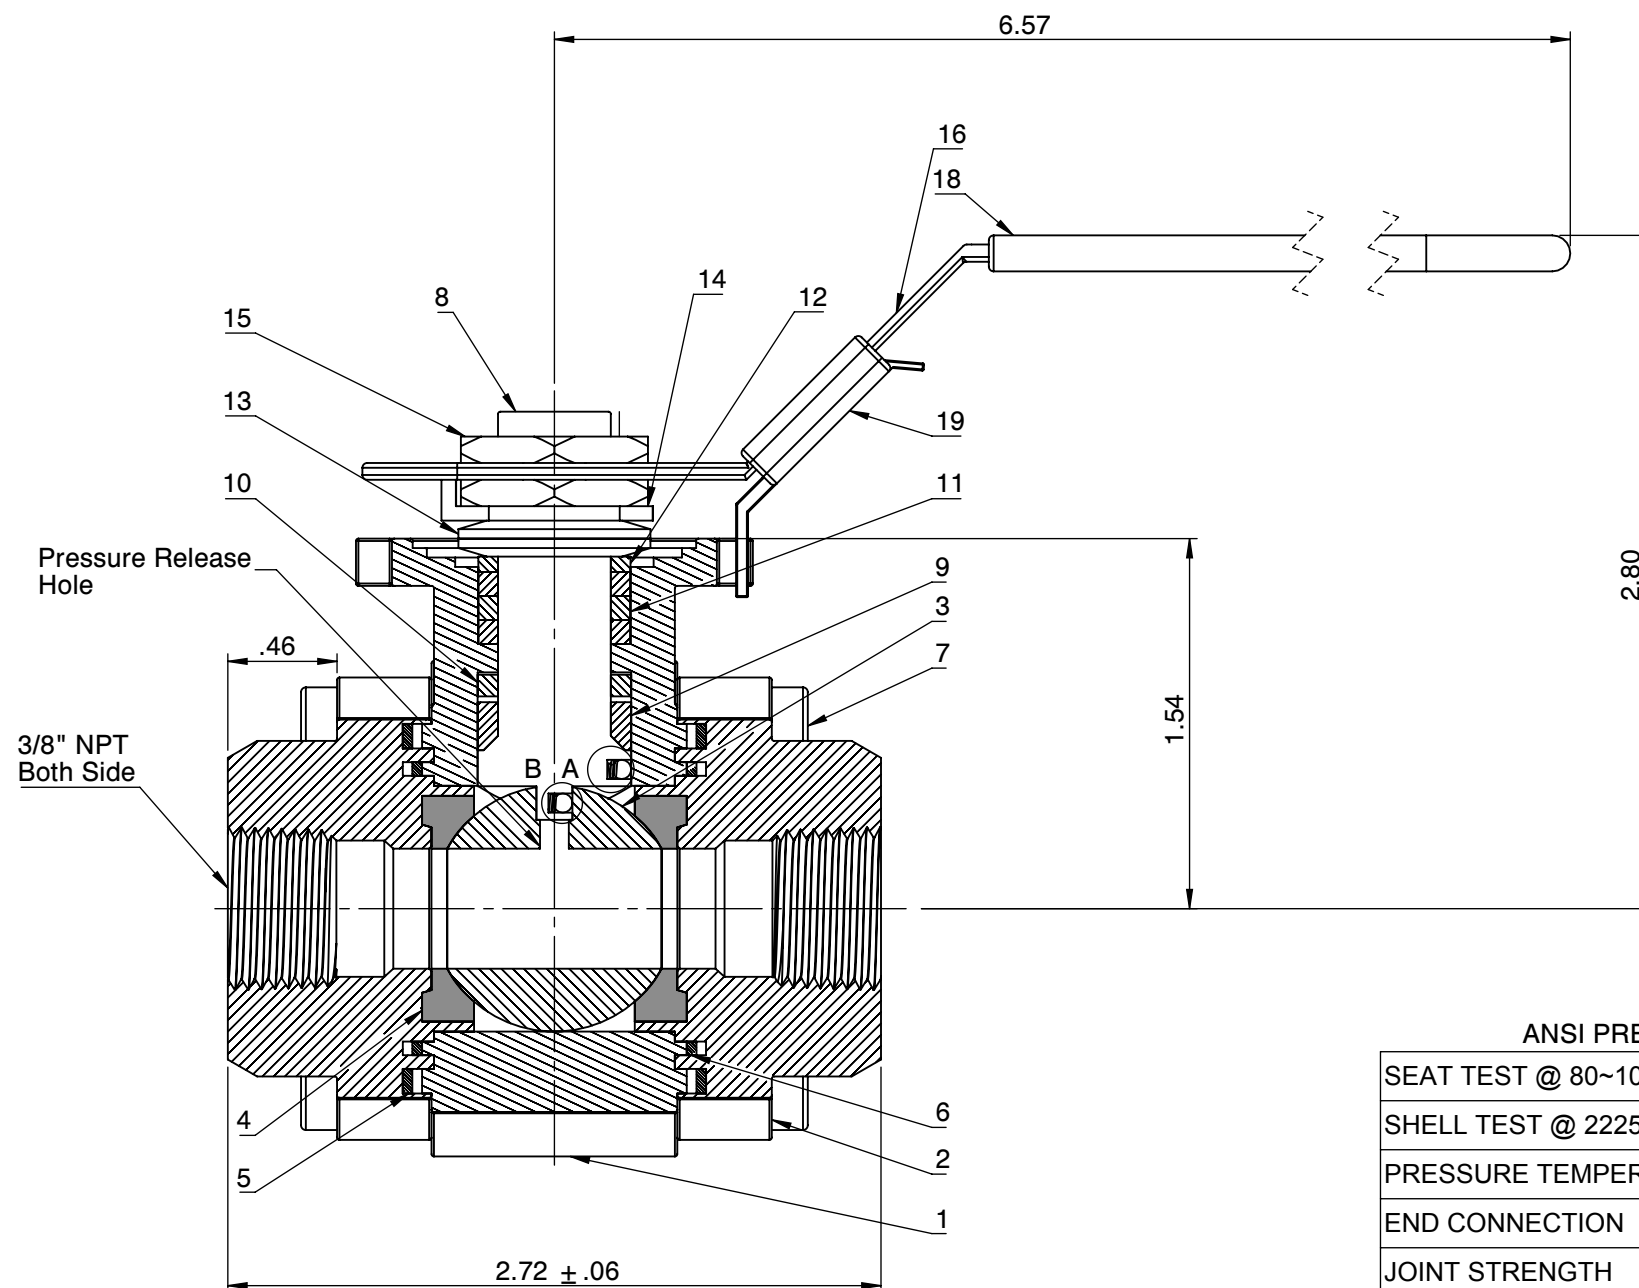

ANSI PRESSURE RATING CLASS 600/3000 WOG

SEAT TEST @ 80~100 PSI	ASME B16.34	15	Stem Nut	SS304
SHELL TEST @ 2225 PSI	ASME B16.34	16	Handle	SS304
PRESSURE TEMPERATURE RATING	ASME B16.34	17	Stopper	SS304
END CONNECTION	ASME B16.11	18	Plastic Cover	Plastic
JOINT STRENGTH	ASME B16.34	19	Locking Device	SS304
WALL THICKNESS	ASME B16.34	20	Anti-Static Spring	SS301
BASIC DESIGN	ASME B16.34	21	Anti-Static Ball	SS316

FOR CERTIFIED DRAWINGS CONSULT FACTORY	Drawn by : M	Date : November 9, 2018	Scale : Not To Scale	Rev : 0	Drawing Title: NPT 3/8"FULL BORE BALL VALVE	FLO TITE™ 4815 W. 5th Street Lumberton, NC 28358 Website: www.flotite.com	Tel : 910-738-8904 Fax : 910-738-9112 E-mail : flotite@flotite.com
	Checked by : M	Date : November 9, 2018	Unit : Inch	Sheet : xxx	Drawing No.: DT-HPF41CS1FGGL-10		
	Approved by : M	Date : November 9, 2018	Material : See Notes				

REVIEW ALL STANDARD SOFT PARTS FOR APPLICATION COMPATIBILITY