




Tri-Pro Series 2250WOG WCB TFM Seat  
NON FIRE SAFE SIZE 1-1/2"

HPF43-CS-3-F-F-F-L-40

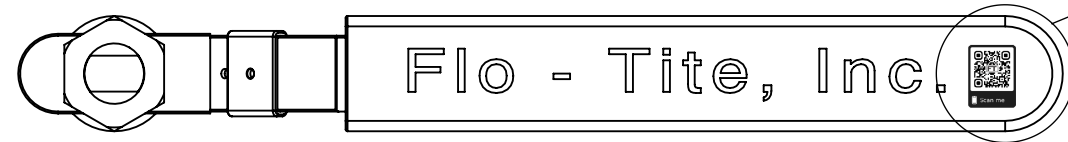


QR CODE

Actuator ISO Mounting Flange (F07)

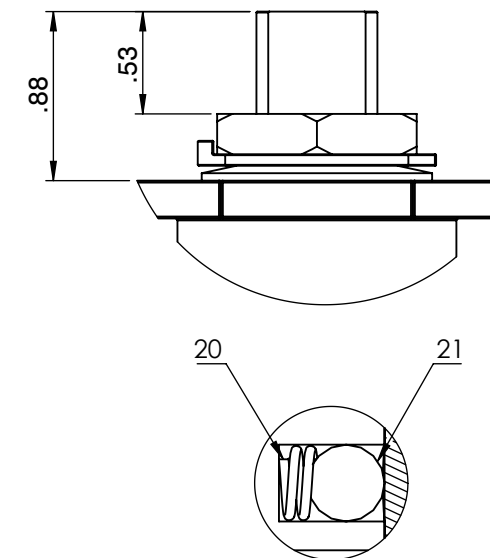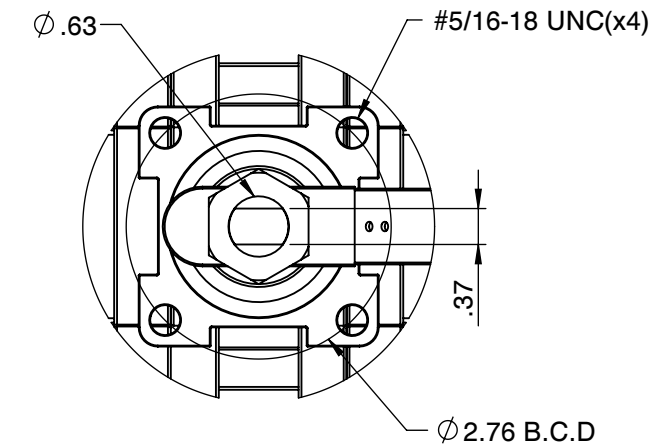

DETAIL : A  
DETAIL : B

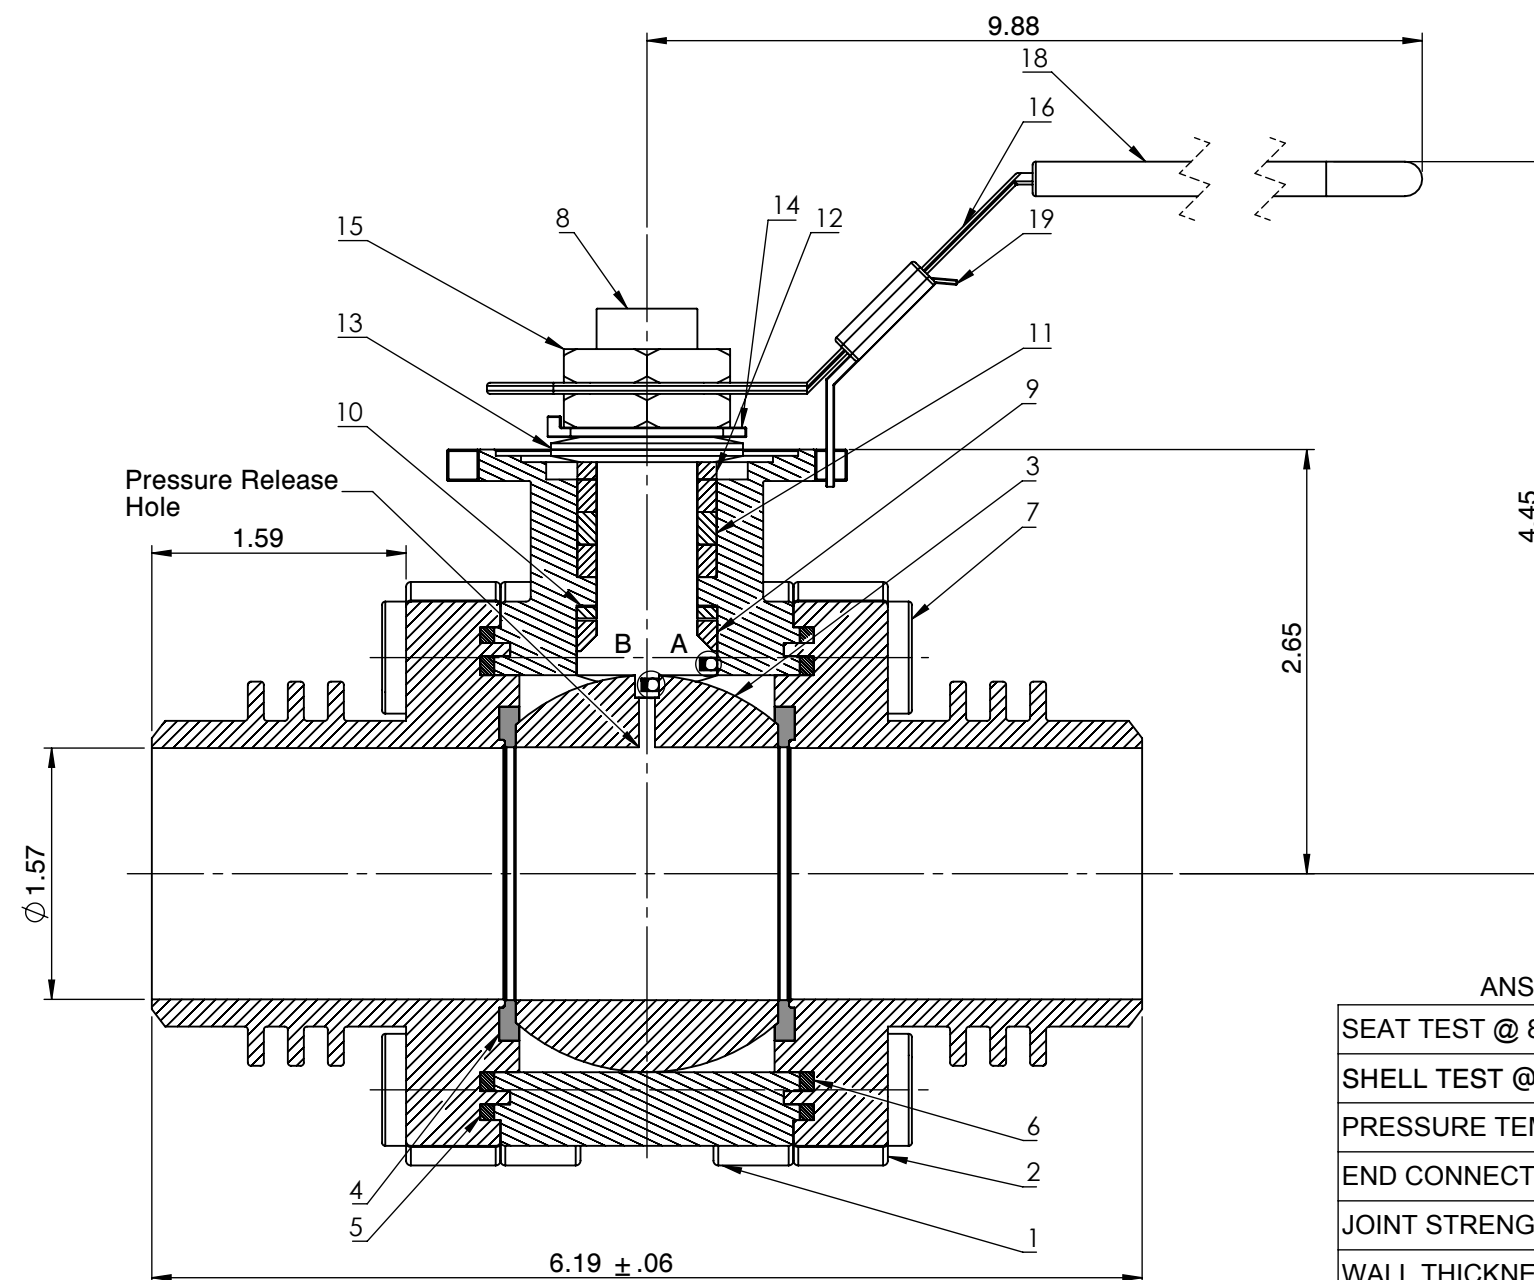

ANSI PRESSURE RATING CLASS 600/2250 WOG

|                             |             |    |                    |         |
|-----------------------------|-------------|----|--------------------|---------|
| SEAT TEST @ 80~100 PSI      | ASME B16.34 | 15 | Stem Nut           | SS304   |
| SHELL TEST @ 2225 PSI       | ASME B16.34 | 16 | Handle             | SS304   |
| PRESSURE TEMPERATURE RATING | ASME B16.34 | 17 | Stopper            | SS304   |
| END CONNECTION              | ASME B16.25 | 18 | Plastic Cover      | Plastic |
| JOINT STRENGTH              | ASME B16.34 | 19 | Locking Device     | SS304   |
| WALL THICKNESS              | ASME B16.34 | 20 | Anti-Static Spring | SS301   |
| BASIC DESIGN                | ASME B16.34 | 21 | Anti-Static Ball   | SS316   |

FOR CERTIFIED  
DRAWINGS CONSULT  
FACTORY

Drawn by : M  
Checked by : M  
Approved by : M  
Date : November 9, 2018  
Date : November 9, 2018  
Date : November 9, 2018  
Scale : Not To Scale  
Unit : Inch  
Material : See Notes  
Rev : 0  
Sheet : xxx

Drawing Title: BW 1-1/2"FULL BORE BALL VALVE  
Drawing No.: DT-HPF43CS3FFFL-40

**FLO-TITE™**

4815 W. 5th Street  
Lumberton, NC 28358  
Website: www.flotite.com  
Tel : 910-738-8904  
Fax : 910-738-9112  
E-mail : flotite@flotite.com

REVIEW ALL STANDARD SOFT PARTS FOR APPLICATION COMPATIBILITY