




Tri-Pro Series 2250WOG 316SS TFM Seat
FIRE SAFE API 607-7 SIZE 1-1/2"

HPF53-SS-3-F-G-G-L-40

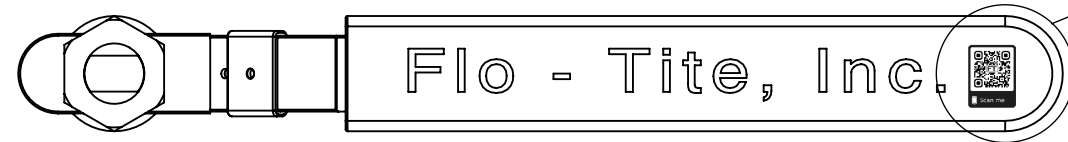


QR CODE

Actuator ISO Mounting Flange (F07)

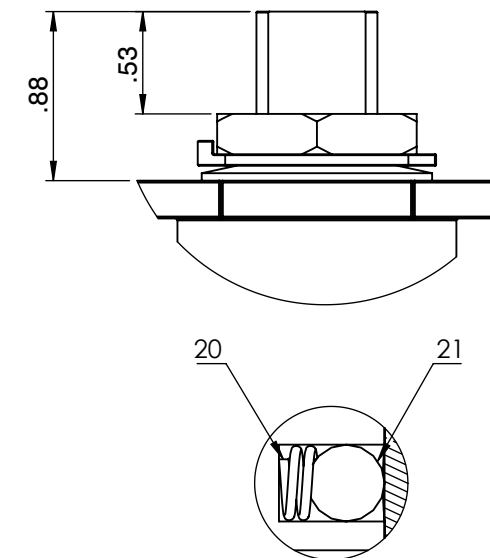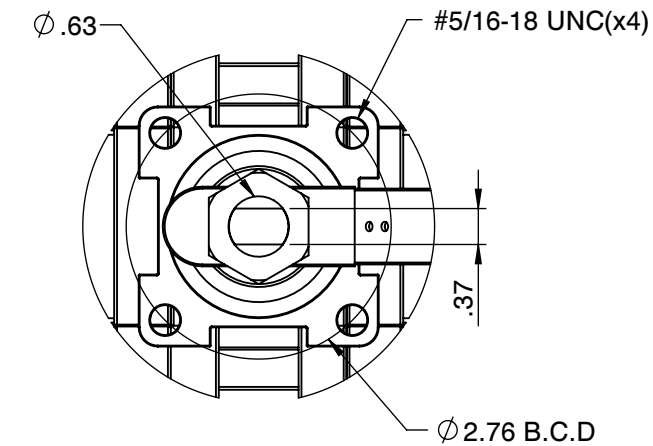

DETAIL : A
DETAIL : B

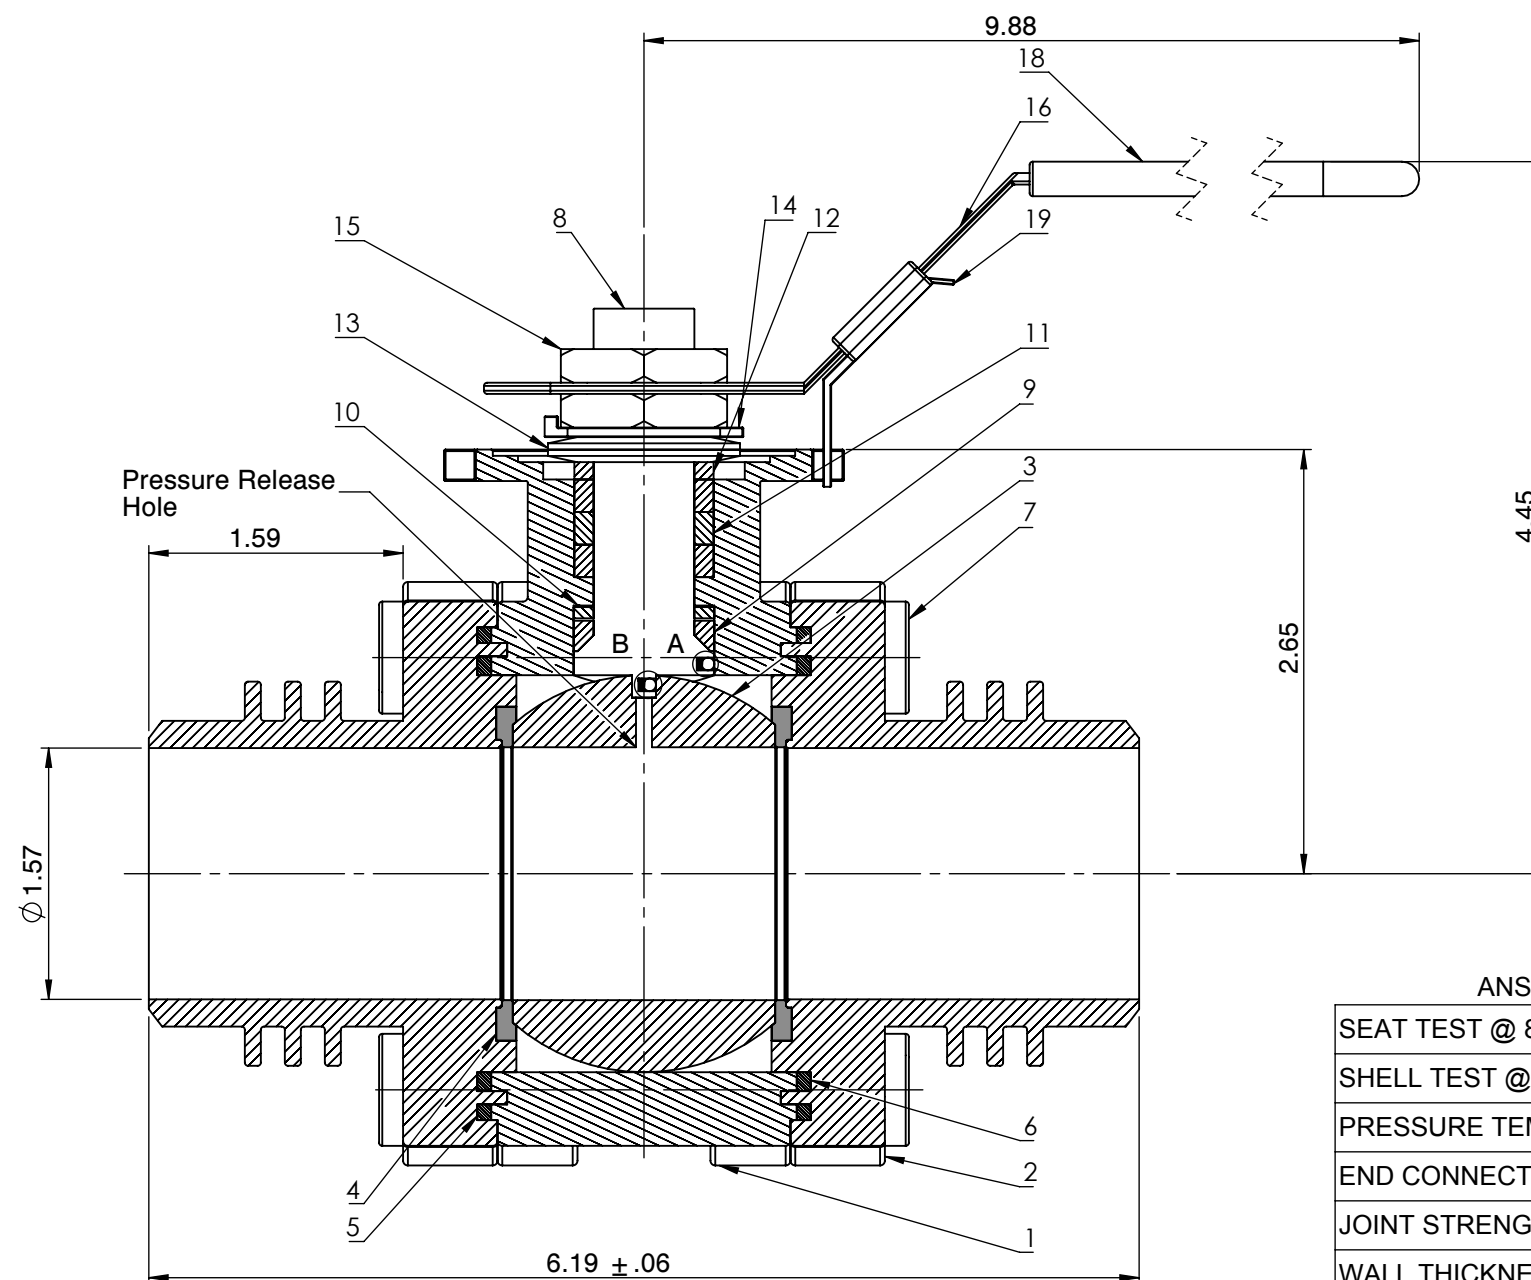

ANSI PRESSURE RATING CLASS 600/2250 WOG

SEAT TEST @ 80~100 PSI	ASME B16.34	15	Stem Nut	SS304
SHELL TEST @ 2175 PSI	ASME B16.34	16	Handle	SS304
PRESSURE TEMPERATURE RATING	ASME B16.34	17	Stopper	SS304
END CONNECTION	ASME B16.25	18	Plastic Cover	Plastic
JOINT STRENGTH	ASME B16.34	19	Locking Device	SS304
WALL THICKNESS	ASME B16.34	20	Anti-Static Spring	SS301
BASIC DESIGN	ASME B16.34	21	Anti-Static Ball	SS316

FOR CERTIFIED
DRAWINGS CONSULT
FACTORY

Drawn by : M Date : November 9, 2018 Scale : Not To Scale Rev : 0
Checked by : M Date : November 9, 2018 Unit : Inch Sheet : xxx
Approved by : M Date : November 9, 2018 Material : See Notes

Drawing Title: BW 1-1/2"FULL BORE BALL VALVE
Drawing No.: DT-HPF53SS3FGGL-40

FLO TITE™

4815 W. 5th Street Tel : 910-738-8904
Lumberton, NC 28358 Fax : 910-738-9112
Website: www.flotite.com E-mail : flotite@flotite.com

REVIEW ALL STANDARD SOFT PARTS FOR APPLICATION COMPATIBILITY