sales@flotite.com



FTSV Series



All valves are Fire Safe Tested & certified to API 607 No air supply or electricity needed for the FTSV

CRITICAL COMPONENTS

1) Fire-Safe Valve

Tri-Pro HPF Series

High Performance Series



The Tri-Pro and HP Series are one example of Fire Safe Valves Flo-Tite offers. Choose a Fire Safe ball or butterfly valve. All valves are equipped with special seats and seals to attain the API 607 4, 5 or 7th edition Fire-Safe rating. All valves are available in carbon or stainless steel.

Ball Valves

NPT: 1/4" to 4" Socket Weld: 1/4" to 4" 150# ANSI RF Flange: 1/2" to 8"

300# ANSI RF Flange: 1/2" to 10"

600# ANSI RF Flange:

Butterfly Valves

150#,300#, 600#,900# ANSI Flange for Lug & Wafer models: 2" to 12" *visit flotite.com* web page for details

Flo-Tite's Thermal Shut Off Valves

The **FTSV** series Thermal Shut-off valves combine a fire-safe ball or butterfly valve with a pneumatic actuator and the **FM approved** *FireChek***®** valve to form a dedicated stand-alone thermal shut-off valve that will close (or open) at a given temperature (165° F standard). This alternative to fusible link valves can be tested and reset without the need to replace any hardware.

The valve is held open by charging the actuator through a Schrader (check) valve. There is a clearly labeled gauge to indicate the proper pressure range to maintain. **FTSV**'s have passed both Mil-std-810G humidity vibration testing procedures through an independent third party. Each **FTSV** assembly is also individually tested by a qualified technician in our ISO certified facility after assembly.

The FTSV has passed the 13,000 mile vibration test and the 5 year humidity test.

2) Spring Return Actuator Air-Con Actuator



Air-Con C Series

These actuators are sized by our engineers specifically for thermal shutoff functionality. Actuators accept 70-125 psi and springs have a generous safety factor included to ensure closure even if the break torque is increased due to the valve not being actuated for a long period of time. These actuators were selected because they are rugged and economical and they have the ISO 5211 and NAMUR mounting patterns. The FTSV thermal shutoff module directly mounts to the NAMUR pad. *visit airconactuators.com for details*



3) FM Approved FireChek®

Inline 3-way Thermal Shut-off

The revolutionary FireChek valve is what provides the functionality of the FTSV module. It uses a patented shape memory spring that makes it expand at the designed trigger (165 °F) temperature. Air can flow through the valve in one direction to enter the actuator during normal temperatures. After the valve is triggered by excessive heat, it


self-actuates and vents the actuator allowing the springs to close the ball or butterfly valve.

Only FM approved using AirCon Actuators.

Notes: FTSV Package Includes: FTSV Module, 165F FM approved Firechek thermal valve, Visual Liquid Filled Guage, O-rings and Bolts for Namur mounting. Fully Assembled and Tested. Instruction manual for installation and operation. Weight: 1.00 lbs. each

List Price: \$2,955

Mounted Price: \$3,150

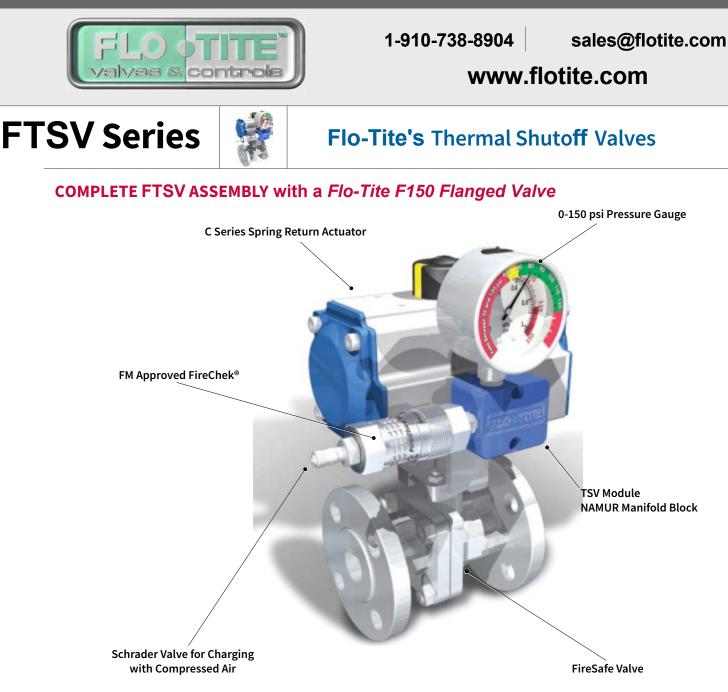

GENERAL OPERATION INSTRUCTIONS

- 1. Install the FTSV valve assembly into the piping system.
- 2. Remove the cap from the schrader valve on the FireChek's inlet.
- **3.** Attach the compact air pump or hose from a regulated air source to the schrader valve. Be sure that the pump or regulator is set to 120 psi.
- **4.** Fill the actuator until the pressure gauge reads 120 psi. You will see the actuator begin to rotate via the indicator cap as the pressure rises. Once the actuator rotates the full 90 degrees it will stop rotating but the pressure will continue to rise until it reaches 120 psi.
- 5. Detach the compressed air source and replace the cap on the schrader valve.
- 6. The installation of the FTSV is now complete. The Fire-safe valve will now be held open (or closed depending on the application) until the ambient temperature around the FireChek reaches 165° F (other temperatures available) at which point, the FireChek will vent the actuator which will force the valve to close.
- 7. Inspect the pressure using the gauge periodically to be sure that it is in the green zone. If the pressure ever falls below 70 psi and the needle enters the yellow zone of the gauge, re-charge the actuator back to 120 psi.
- 8. All valves are Fire Safe Tested & certified to API 607.





FTSV Series



Thermal Shutoff Valves

Series	-150 Valve		CS erial	– L Siz	 J-FC Ter		Acces	sorie
<pre>s:</pre>	Valve	Inde			101		Acces	
<pre>= Thermal Shutoff Valve Type: F = 150# ANSI RF Flanged Firesafe Ball Valve (1/2" to 8") F = 300# ANSI RF Flanged Firesafe Ball Valve (1/2" to 10") N = NPT Female Connection Firesafe Ball Valve (1/2" to 4") -SW = Socket Weld Firesafe Ball Valve (1/2" to 4") = 150# Lugged Style ANSI Flanged Firesafe Butterfly Valve (2" to V = 150# Wafer Style ANSI Flanged Firesafe Butterfly Valve (2" to Material: Carbon Steel = 1/2" = 3/4" = 1" = 1 1/2" = 2" = 2 1/2" = 3" = 4" = 6" = 8" D = 10" D = 12" ter Temperature:</pre>								
$F' = 150\# \text{ ANSI RF Flanged Firesafe Ball Valve (1/2" to 8")}$ $F = 300\# \text{ ANSI RF Flanged Firesafe Ball Valve (1/2" to 10")}$ $N = \text{NPT Female Connection Firesafe Ball Valve (1/2" to 4")}$ $F = 300\# \text{ Lugged Style Ansi Flanged Firesafe Butterfly Valve (2" to 4")}$ $F = 150\# \text{ Wafer Style Ansi Flanged Firesafe Butterfly Valve (2" to 5")}$ $F = 150\# \text{ Wafer Style Ansi Flanged Firesafe Butterfly Valve (2" to 5")}$ $F = 3/4"$ $F = 11/2"$ $F = 11/2"$ $F = 2"$ $F = 11/2"$ $F = 3"$ $F = 4"$ $F = 6"$ $F = 8"$ $F = 10"$ $F = 165^{\circ}F (\text{standard})$								
$F' = 150\# \text{ ANSI RF Flanged Firesafe Ball Valve (1/2" to 8")}$ $F = 300\# \text{ ANSI RF Flanged Firesafe Ball Valve (1/2" to 10")}$ $N = \text{NPT Female Connection Firesafe Ball Valve (1/2" to 4")}$ $F = 300\# \text{ Lugged Style Ansi Flanged Firesafe Butterfly Valve (2" to 4")}$ $F = 150\# \text{ Wafer Style Ansi Flanged Firesafe Butterfly Valve (2" to 5")}$ $F = 150\# \text{ Wafer Style Ansi Flanged Firesafe Butterfly Valve (2" to 5")}$ $F = 3/4"$ $F = 11/2"$ $F = 11/2"$ $F = 2"$ $F = 11/2"$ $F = 3"$ $F = 4"$ $F = 6"$ $F = 8"$ $F = 10"$ $F = 165^{\circ}F (\text{standard})$								
-N = NPT Female Connection Firesafe Ball Valve (1/2" to 4") -SW = Socket Weld Firesafe Ball Valve (1/2" to 4") = 150# Lugged Style ANSI Flanged Firesafe Butterfly Valve (2" to 7 Material: = Carbon Steel = 1/2" = 3/4" = 1" = 1 1/2" = 2" = 2 1/2" = 3" = 4" = 6" = 8" D = 10" D = 10" D = 12" Entropy of the second sec								
<pre>-SW = Socket Weld Firesafe Ball Valve (1/2" to 4")</pre>								
<pre>= 150# Lugged Style ANSI Flanged Firesafe Butterfly Valve (2" to = 150# Wafer Style ANSI Flanged Firesafe Butterfly Valve (2" to Material: = carbon Steel = carbon Steel = stainless Steel = 1/2" = 3/4" = 1" = 1 1/2" = 2" = 2 1/2" = 2 1/2" = 3" = 4" = 6" = 8" 0 = 10" 0 = 12" er Temperature: = 165°F (standard)</pre>								
<pre>V = 150# Wafer Style ANSI Flanged Firesafe Butterfly Valve (2" to ' Material:</pre>	12")							
<pre>= Carbon Steel = Stainless Steel = 1/2" = 3/4" = 1 " = 1 1/2" = 2 1/2" = 2 1/2" = 3" = 4" = 6" = 8" 0 = 10" 0 = 12" er Temperature: </pre>								
<pre>= Carbon Steel = Stainless Steel = 1/2" = 3/4" = 1 " = 1 1/2" = 2 1/2" = 2 1/2" = 3" = 4" = 6" = 8" 0 = 10" 0 = 12" er Temperature: </pre>								
$= 1/2'' = 3/4'' = 1'' = 1'' = 1 1/2'' = 2'' = 2 1/2'' = 3'' = 4'' = 6'' = 8'' = 0 = 10'' = 0 = 12'' = 12'' = 12'' = 165^{\circ}F (standard)$								
= 1/2" = 3/4" = 1" = 1 1/2" = 2" = 2 1/2" = 3" = 4" = 6" = 8" 0 = 10" 0 = 12" er Temperature: 								
= 1/2" = 3/4" = 1" = 1 1/2" = 2" = 2 1/2" = 3" = 4" = 6" = 8" 0 = 10" 0 = 12" er Temperature: 								
= 1" = 1 1/2" = 2" = 2 1/2" = 3" = 4" = 6" = 8" D = 10" D = 12" er Temperature: 165 = 165°F (standard)								
= 1 1/2" = 2" = 2 1/2" = 3" = 4" = 6" = 8" D = 10" D = 12" er Temperature: 165 = 165°F (standard)								
= 2" = 2 1/2" = 3" = 4" = 6" = 8" D = 10" D = 12" er Temperature: 								
= 2 1/2" = 3" = 4" = 6" = 8" D = 10" D = 12" er Temperature: 								
= 3" = 4" = 6" = 8" D = 10" D = 12" er Temperature: 165 = 165°F (standard)								
= 4" = 6" = 8" D = 10" D = 12" er Temperature: 								
= 6" = 8" 0 = 10" 0 = 12" er Temperature: 								
= 8" 0 = 10" 0 = 12" er Temperature: 165 = 165°F (standard)								
0 = 10" 0 = 12" er Temperature:								
0 = 12" er Temperature:								
er Temperature:								
165 = 165°F (standard)								
						J		
160 - 160°E								
135 = 135°F								

Limit Switches

We carry a full line of limit switches that can be added for valve position monitoring. Call to discuss





Large Selection of Quarter Turn Valve Actuators



AirCon's products are used in almost every energy related industry, including oil and gas production, oil and gas transmission, and petroleum refining. Other markets include chemical, petrochemical, pulp and paper, food and beverage, and water systems.



4815 West 5th St. Lumberton, N.C. 28358

PH: 910-738-2866 www.airconinc.com

Updated 1/30/2023